







#### D. Copper Tubing Design

The copper tube heat exchanger should extra 395.45 W. For effective heat transfer between the refrigerant and the copper ambient air, the refrigerant is set to evaporate at  $-3^{\circ}\text{C}$  inside the tube. This gives a saturation pressure of 178 kPa and hence a latent heat of vaporization of 160.2 kJ/kg. The mass flow rate of the refrigerant is then 0.00257 kg/s. For the selected unit, the copper tube has an internal diameter of 0.011 m. Therefore the velocity of flow is 0.05 m/s giving a Reynolds number of 2527.07 which is in the turbulent flow regime. The Nussult number is then 18.2. For this the internal convective heat transfer coefficient ( $h_i$ ) is 121.64  $\text{W/m}^2\text{-K}$ . For external heat transfer coefficient ( $h_o$ ) the Prandtl number is 0.71 and the Grashof-Prandtl number is obtained as 2022.24. This leads to  $h_o = 16.3 \text{ W/m}^2\text{-K}$  for an outside tube diameter of 0.0127 m. The overall heat transfer coefficient for is then  $h = 12.6 \text{ W/m}^2\text{-K}$ .

The heat transfer energy balance (eqn. 1) gives the heat transfer area as  $1.08 \text{ m}^2$  and a corresponding tube length of 27 m. This is then arranged on the testing chamber ceiling as shown in the model in Fig. 4. A full set of manufacturing drawings was produced.

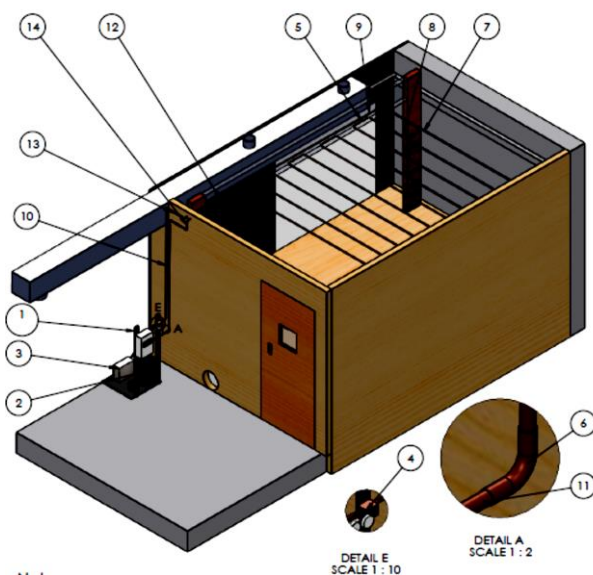


Fig. 4: Configuration of the chilled ceiling copper tubing evaporator

#### IV. CONCLUSIONS AND RECOMMENDATIONS

An independent chilled ceiling system for a standalone office with direct expansion displacement ventilated HVAC system was analyzed and design. Key performance parameter were identified and quantified. The design process led to a splitting of the cooling load between the DV system (65%) and the chilled ceiling (35%). Copper tubing of 27 m length was determined to effect the required ceiling cooling.

The system was constructed, installed and commissioned. The next step in the work is to conduct performance testing of the chilled ceiling system and its effectiveness on improving indoor air quality. It is therefore recommended that full tests be conducted to fully understand the system.

#### ACKNOWLEDGMENTS

We would like to thank the following people for some of the development work on the design construction and commissioning of the testing chamber: Ranwedzi Mukhonobwane, Tlou William Kgaabi and Omphile Masilo.

#### REFERENCES

- [1] US Department of Energy, "Buildings Energy Data Book," US Department of Energy, 2015. [Online]. Available: <https://catalog.data.gov/dataset/buildings-energy-data-book>. [Accessed 28 June 2015].
- [2] L. Bellia, F. De Falco and F. Manichiello, "Effects of Solar Shading Devices on Energy Requirements of Standalone Office Buildings for Italian Climates," *Applied Thermal Engineering*, vol. 54, pp. 190-201, 2013.
- [3] Q. Luo, G. Tang and W. Huang, "Investigation of Airconditioning Energy Consumption of a Typical Commercial Building Complex," *International Journal on Architectural Science*, vol. 4, no. 6, pp. 178-183, 2005.
- [4] C. P. Botha, *Simulation of a Building Heating, Ventilation and Airconditioning System*, Pretoria: University of Pretoria, 2000.
- [5] K. J. Chua, S. K. Chou, W. M. Yang and J. Yan, "Achieving Better Energy-efficient Air Conditioning – A Review of Technologies and Strategies," *Applied Energy*, vol. 104, pp. 87-104, 2013.
- [6] K. F. Fong, C. K. Lee, Z. Lin, T. T. Chow and L. S. Chan, "Application potential of solar air-conditioning systems for displacement ventilation," *Energy and Buildings*, vol. 43, pp. 2068-2076, 2011.
- [7] S. Hussain and P. H. Oosthuizen, "Numerical Investigations of Buoyancy-driven Natural Ventilation in a Simple Three Storey Atrium Building and Thermal Comfort Evaluation," *Applied Thermal Engineering*, 2013.
- [8] A. Sharma, V. V. Tyagi, C. R. Chen and D. Buddhi, "Review on Thermal Energy Storage with Phase Change Materials and Applications," *Renewable and Sustainable Energy Reviews*, vol. 13, pp. 318-345, 2009.
- [9] D. M. Madyira and M. Bhamjee, "Comparative Study of the Performance of Displacement vs Conventional Ventilation using CFD," in *Proceedings of the Third IASTED Africa Conference - Modelling and Simulation*, Gaborone, 2010.
- [10] D. Manzoni and P. Guitton, "Validation of Displacement Ventilation Simplified Models," [Online]. Available: [http://www.inive.org/members\\_area/medias/pdf/Inive%5CIBPSA%5CUFSC589.pdf](http://www.inive.org/members_area/medias/pdf/Inive%5CIBPSA%5CUFSC589.pdf). [Accessed 28 June 2015].
- [11] T. Webster, F. Bauman and J. Reese, "Underfloor Air Distribution: Thermal Stratification," *ASHRAE Journal*, pp. 28-33, 2002.
- [12] ASHRAE, *Thermal Environment Conditions for Human Occupancy*, ASHRAE, 2013.
- [13] TROX South Africa (Pty) Ltd, "Type FBA - FBK," TROX Technik, 2013. [Online]. Available: [http://www.troxsa.co.za/sa/products/air\\_diffusers/floor\\_diffusers/fba\\_fbk/index.html](http://www.troxsa.co.za/sa/products/air_diffusers/floor_diffusers/fba_fbk/index.html). [Accessed 28 June 2015].
- [14] H. Tan, T. Murata, K. Aoki and T. Kurabuchi, "Cooled Ceilings / Displacement Ventilation Hybrid Air COnditioning System - Design Criteria," in *Proceedings of Roomvent '98*, 1998.
- [15] A. Novoselac and J. Srebric, "A critical Review on the Performance and Design of Combined Cooled Ceiling and Displacement Ventilation Systems," *Energy and Buildings*, vol. 34, pp. 497-50, 2002.
- [16] A. Keblawi, N. Ghaddar, K. Ghali and L. Jensen, "Chilled Ceiling Displacement Ventilation Design Charts Correlations to Employ in Optimised System Operation for Feasible Load Ranges," *Energy and Buildings*, vol. 41, pp. 1155-1164, 2009.